


VITI AUTOFILETTANTI A TESTA SVASATA PIANA E IMPRONTA A CROCE PH

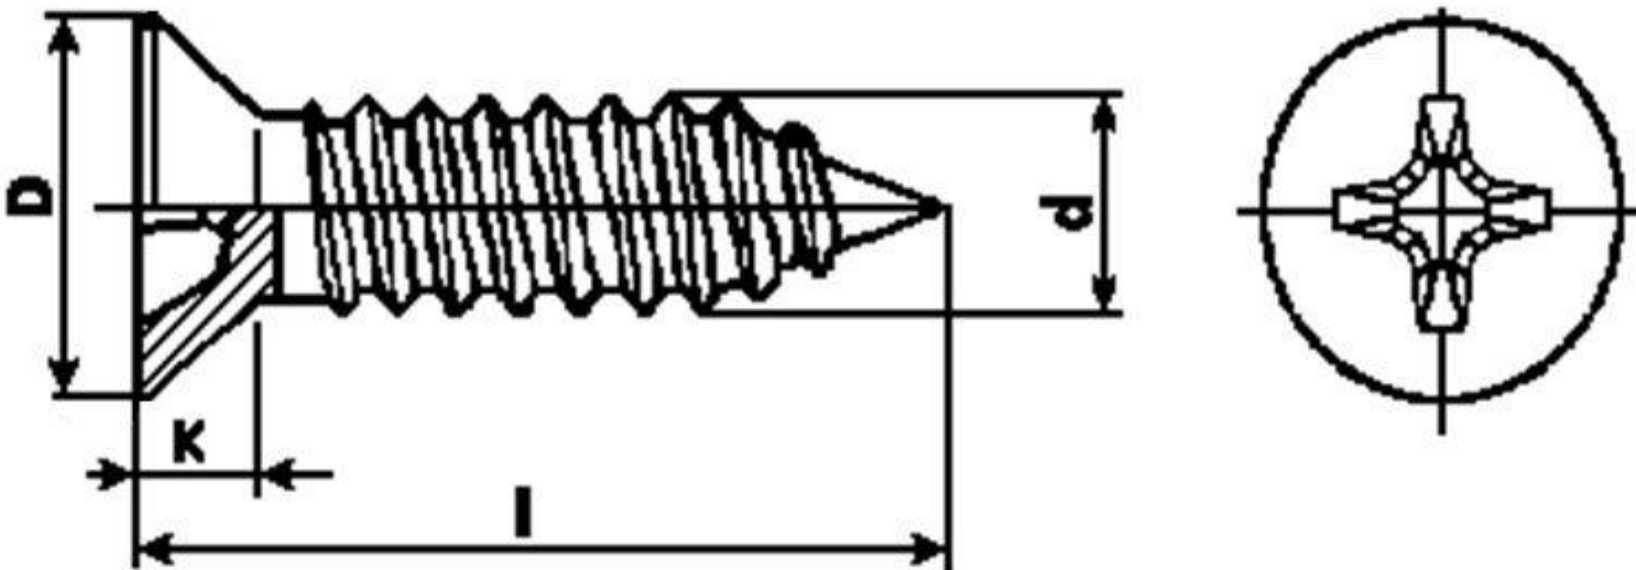

d		2,2	2,9	3,5	3,9	4,2	4,8	5,5	6,3
N.° ISO		2	4	6	7	8	10	12	14
D	min.	4	5,2	6,44	7,14	7,74	9,14	10,37	11,97
	max.	4,3	5,5	6,8	7,5	8,1	9,5	10,8	12,4
K		1,3	1,7	2,1	2,3	2,5	3	3,4	3,8
n.° impronta Ph		Ph 1		Ph 2				Ph 3	
l									
mm	pollici								
4,5	3/16"								
6,5	1/4"								
9,5	3/8"								
13	1/2"								
16	5/8"								
19	3/4"								
22	7/8"								
25	1"								
32	1" 1/4								
38	1" 1/2								
45	1" 3/4								
50	2"								

V55