


VITI AUTOFILETTANTI A TESTA SVASATA CON CALOTTA E IMPRONTA A CROCE PH

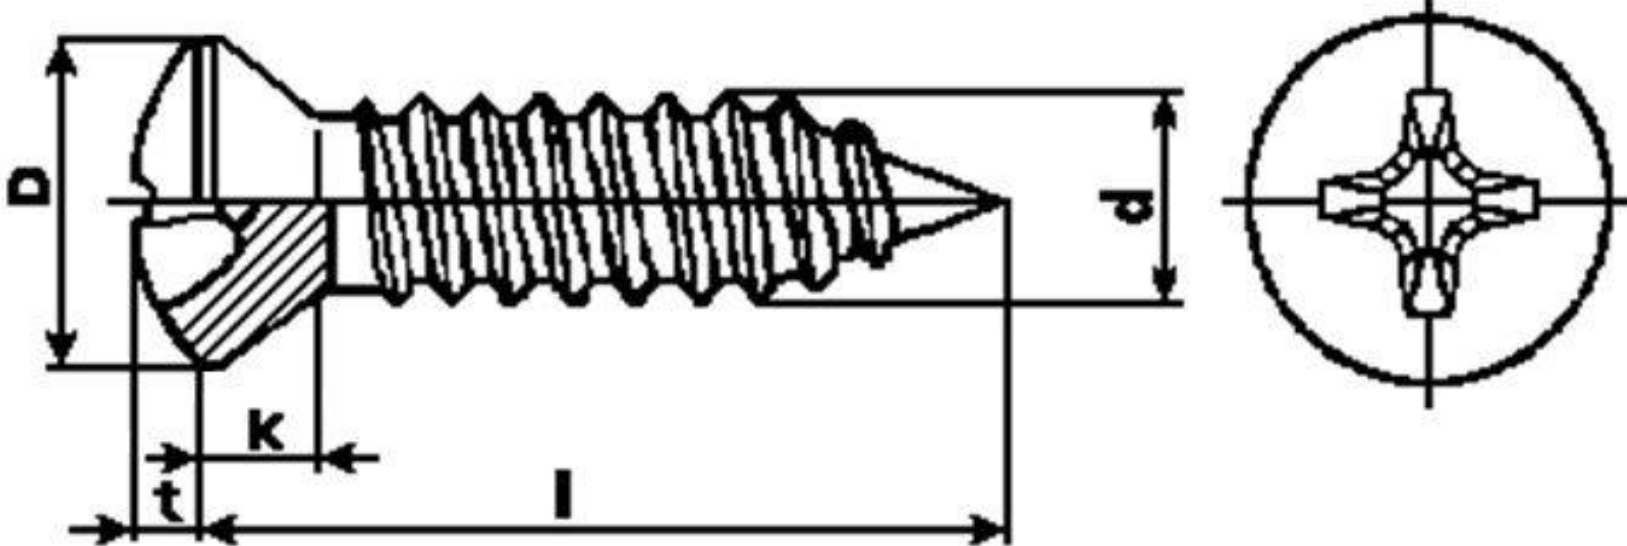

d		2,2	2,9	3,5	3,9	4,2	4,8	5,5	6,3
N.° ISO		2	4	6	7	8	10	12	14
D	min.	3,9	5,3	6,54	7,14	7,84	9,14	10,37	12,07
	max.	4,2	5,6	6,9	7,5	8,2	9,5	10,8	12,5
K	min.	1,55	1,95	2,35	2,55	2,75	3,25	3,65	4,25
	max.	1,8	2,2	2,6	2,8	3,05	3,55	3,95	4,55
n.° impronta		Ph 1		Ph 2				Ph 3	
l									
mm	pollici								
4,5	3/16"								
6,5	1/4"								
9,5	3/8"								
13	1/2"								
16	5/8"								
19	3/4"								
22	7/8"								
25	1"								
32	1" 1/4								
38	1" 1/2								
45	1" 3/4								
50	2"								